

FILTER HOUSING – AAF HT

DESCRIPTION

AAF HT filter housings have been specifically developed for very high efficient removal of solid particles, water and oil aerosols, from compressed air ⁽¹⁾ systems in high temperature applications. To meet the required compressed air quality appropriate filter element must be installed into filter housing.



APPLICATIONS ⁽²⁾

- General industrial application
- Automotive
- Electronics
- Food & Beverage
- Chemical
- Petrochemical
- Plastics
- Paint

⁽¹⁾ For any other technical gas please contact us or your local dealer

⁽²⁾ AAF HT filter housing can be used in variety of applications. For applications not listed please contact us or your local dealer.

TECHNICAL SPECIFICATION

Operating temperature	1,5 - 120 °C	35 - 248 °F
Operating pressure ⁽³⁾	0 - 10 bar(g)	0 - 145 psi

⁽³⁾ Operating pressure up to 13 bar(g) at operating temperature 85°C on request.

MATERIALS

Housing material	Aluminium
Fittings, Screws	Steel-zinc plated
Cover	PA6
Sealing	FKM
Corrosion protection	Electrophoretic Coating (KTL)
Outside protection	Powder paint coated (Epoxy-polyester base)
Lubricant	Shell cassida grease RLS 2

SIZES

FILTER HOUSING	PIPE SIZE [inch]	FILTER ELEMENT	FLOW CAPACITY		DIMENSIONS [mm]				VOLUME [l]	WEIGHT [kg]
			[Nm ³ /h]	[scfm]	A	B	C	D		
AAF 0006 HT	1/8	03528	10	6	105	55	14	50	0,07	0,23
AAF 0016 HT	1/4	05528	18	11	125	55	14	70	0,09	0,24
AAF 0026 HT	1/4	03844	25	15	145	73	18	50	0,22	0,42
AAF 0036 HT	3/8	03844	30	18	145	73	18	50	0,22	0,42
AAF 0046 HT	1/4	06050	35	22	189	88	32	60	0,44	0,72
AAF 0056 HT	3/8	06050	60	35	189	88	32	60	0,45	0,71
AAF 0076 HT	1/2	07050	78	46	189	88	32	80	0,45	0,70
AAF 0106 HT	3/4	14050	120	70	257	88	32	150	0,64	0,78
AAF 0186 HT	1	12075	198	116	261	125	37	160	1,4	1,9
AAF 0306 HT	1	22075	335	197	361	125	37	250	2,0	2,4
AAF 0476 HT	1 1/2	32075	510	300	461	125	37	350	2,6	2,6
AAF 0706 HT	1 1/2	50075	780	459	641	125	37	530	3,6	3,5

Flow capacity at 7 bar(g), 20°C

Standard is BSP pipe connection, other pipe connection on request.

PRESSURE EQUIPMENT DIRECTIVE PED 2014/68/EU (Fluid group 2)

AAF HT 0006 – AAF HT 0706

Article 4.3

PRESSURE EQUIPMENT DIRECTIVE PED 2014/68/EU (Fluid group 1)⁽³⁾

AAF HT 0006 – AAF HT 0306

Article 4.3

AAF HT 0476 – AAF HT 0706

Category 1, Module H

⁽³⁾ The fluid group must be specified in the order; if not, standard fluid group 2 is selected.

CORRECTION FACTORS

To calculate the correct capacity of a given filter based on actual operating conditions, multiply the nominal flow capacity by the appropriate correction factor(s).

CORRECTED CAPACITY = NOMINAL FLOW CAPACITY x C_{OP}


OPERATING PRESSURE


[bar]	2	3	4	5	6	7	8	9	10
[psi]	29	44	58	72	87	100	115	130	145
C _{OP}	0,38	0,5	0,63	0,75	0,88	1	1,13	1,25	1,38

MAINTENANCE

Replace filter element at least every 12 months or follow the instructions for specific filter element. Once per year make a visual check of filter housing and make sure there is no visual damage.

INFORMATION IN THIS DOCUMENT IS SUBJECT TO CHANGE WITHOUT NOTICE

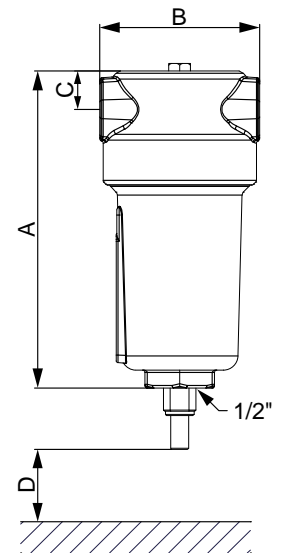

	<p>Our quality management system is certified by BUREAU VERITAS in conformity with ISO 9001:2015 Reg. number: SL22594Q</p>	
---	--	--